

November 13, 2023

Alex Baylor
Environmental Specialist
Prince George's County Public Schools
Environmental Office
13300 Old Marlboro Pike
Upper Marlboro, Maryland 20772

Re: PGCPs Radon Testing Services

Location: Bonnie Johns Educational Center
8437 Landover Road
Landover, MD 20785

Dear Mr. Baylor,

Soil and Land Use Technologies (SaLUT) is pleased to submit the following report to Prince George's County Public Schools (PGCPS) pursuant to completing "short-term" 3-day radon testing for Bonnie Johns Educational Center, located at 8437 Landover Road Landover, MD 20785.

SaLUT conducted short term radon testing to evaluate indoor radon levels relative to the USEPA's recommended action level of 4.0 picocuries per Liter (pCi/L) - the level at which the EPA recommends that schools take action to reduce the level. SaLUT conducted the radon testing following the requirements set forth by PGCPS as well as standards set by the American Association of Radon Scientists and Technologists (AARST).

SaLUT visited the site on 11/03/23 and placed seven (7) activated charcoal radon test kits throughout four (4) rooms. Kits were placed in ground contact rooms that are considered to be frequently occupied and were not previously tested in past years. SaLUT then returned to the school on 11/06/23 to collect the kits. Once all the kits were collected, they were shipped to the Airchek laboratory located in Mills River, North Carolina for analysis.

Within this report you will find a school summary page of the results, the official laboratory analysis report, and a school map with testing locations clearly marked.

If you have any questions or comments regarding this report, please feel free to contact me at (410) 474-2044.

Sincerely,

A handwritten signature in black ink, appearing to read "Thomas Howell", is centered on a light gray rectangular background.

Thomas Howell
Project Manager



Prince George's County Public Schools Radon Testing

School Results Summary

Site Name	Bonnie Johns Educational Center
Date range testing occurred	11/03/23 – 11/06/23
Date Report Delivered	11/13/23
Number of Kits Deployed	7
Number of Rooms Tested	4
Number of rooms \geq 4.0 pCi/L	0
Lowest Value	<0.3 pCi/L
Highest Value	1.9 pCi/L



November 9, 2023

**** LABORATORY ANALYSIS REPORT ****


Radon test result report for:

**BONNIE JOHNS MEDIA CENTER
MAIN**

Kit #	Room Id	Started	Ended	pCi/L	Analyzed
11292431	100B	2023-11-03 @ 1:00 pm	2023-11-06 @ 3:00 pm	0.9 ± 0.3	2023-11-09
11292433	100B	2023-11-03 @ 1:00 pm	2023-11-06 @ 3:00 pm	0.6 ± 0.3	2023-11-09
11292434	108A	2023-11-03 @ 1:00 pm	2023-11-06 @ 3:00 pm	< 0.3	2023-11-09
11292426	108B	2023-11-03 @ 1:00 pm	2023-11-06 @ 3:00 pm	< 0.3	2023-11-09
11292432	108B	2023-11-03 @ 1:00 pm	2023-11-06 @ 3:00 pm	0.9 ± 0.3	2023-11-09
11292435	MATERIALS WING BY STAGE	2023-11-03 @ 1:00 pm	2023-11-06 @ 3:00 pm	1.9 ± 0.3	2023-11-09
11292436	MATERIALS WING IN BACK HALLWAY	2023-11-03 @ 1:00 pm	2023-11-06 @ 3:00 pm	< 0.3	2023-11-09

Air Chek 1936 Butler Bridge Rd, Mills River, NC 28759-3892 Phone: (828) 684-0893 Fax: (828) 684-8498

BONNIE JOHNS MEDIA CENTER

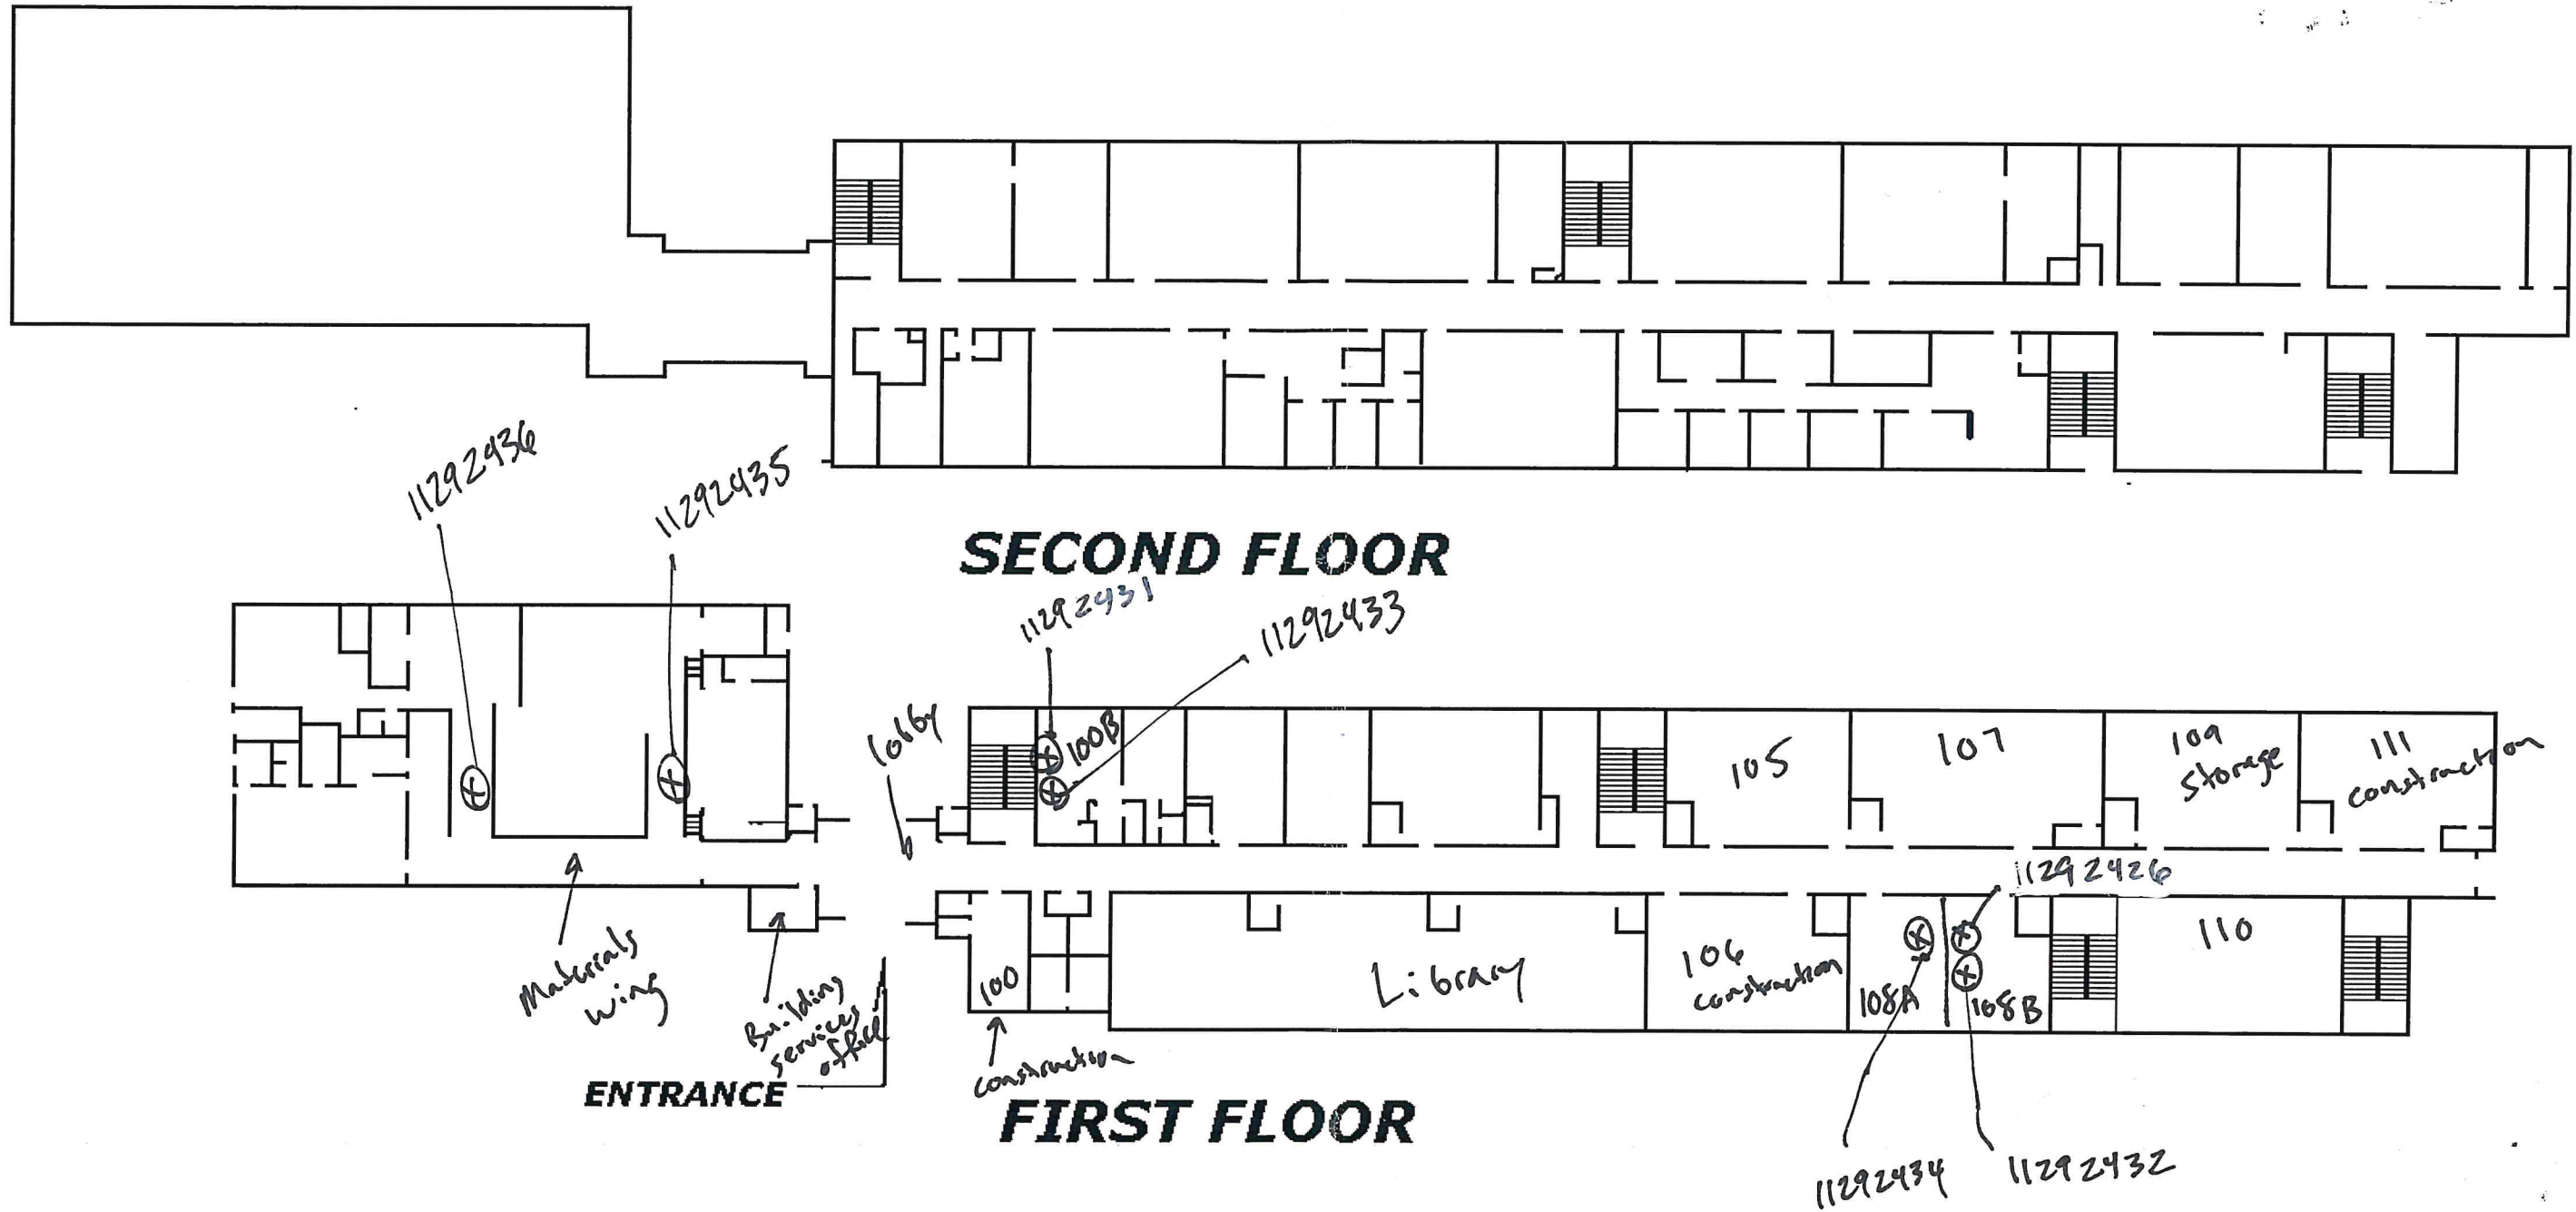

Prepared by Dennis Dill
Environmental Inspector